
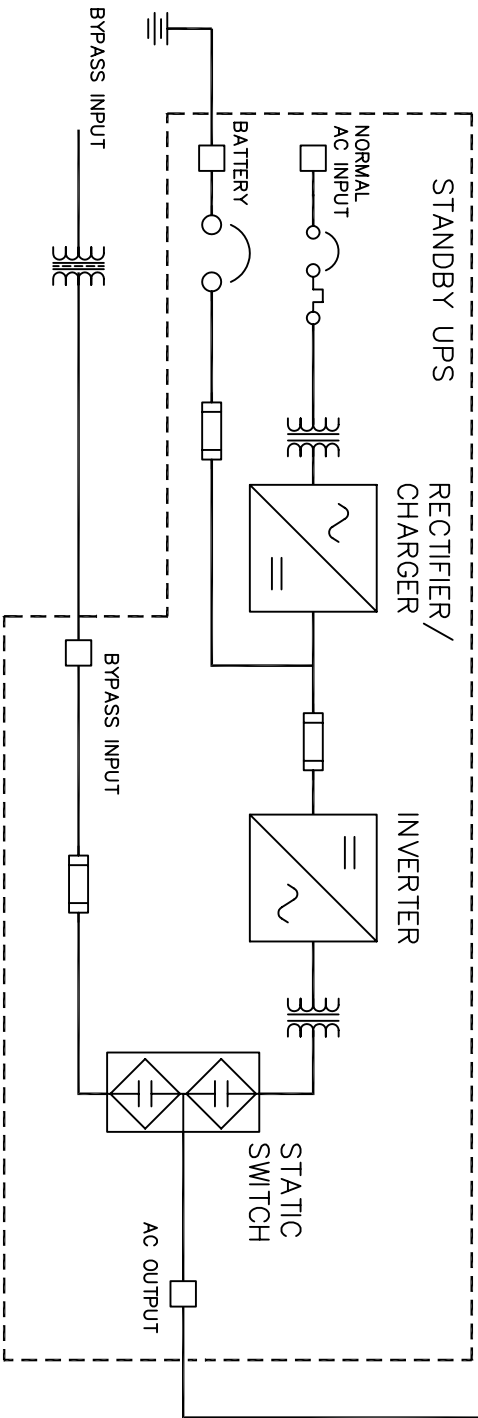


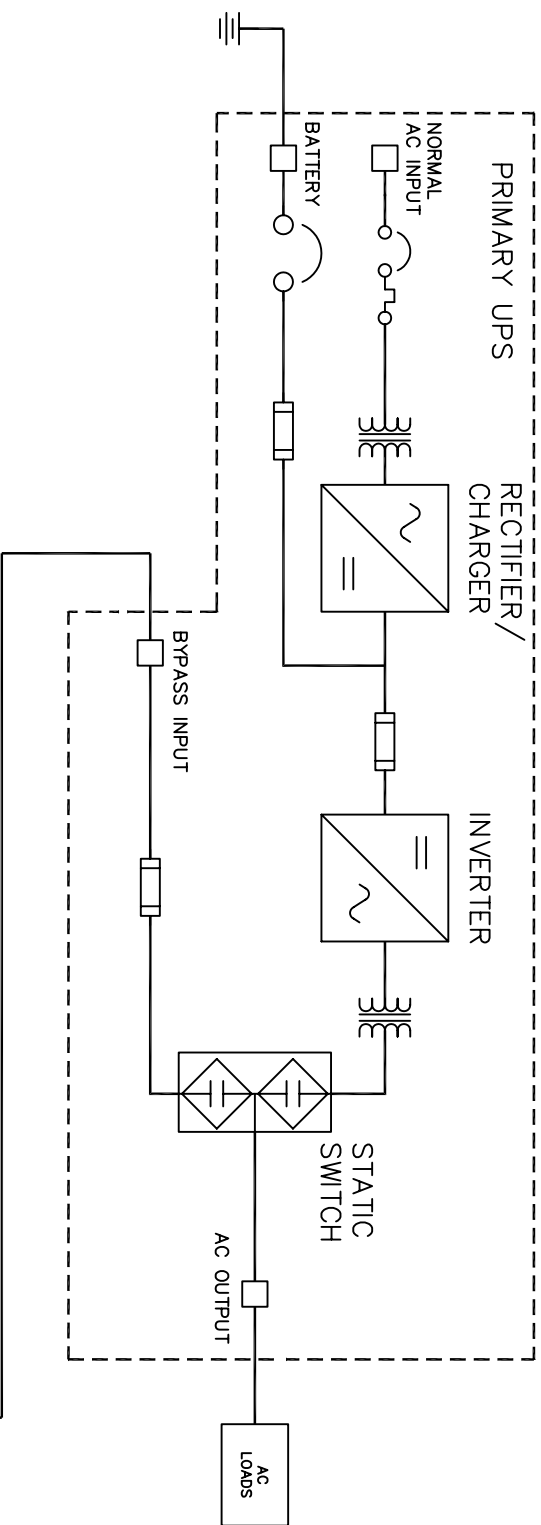

ONE LINE DIAGRAM CASCADED UPS

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCE ON FRACTIONS $\pm 1/32$ DECIMALS ± 0.031 ANGLES $\pm 1.5^\circ$		SCALE
DESIGN	DATE	
DRAWN WALLACE	DATE 9-24-03	
CHKD	DATE	
APPD	DATE	

ITI

POWER SYSTEMS, INC.
ELYRIA, OHIO 44035-7822

PROUPS_REDUN2

SHEET 1 OF 1

ISSUE 1